

ADDENDUM NO. 1 TO THE BIDDING DOCUMENTS
LIFT STATION GENERATOR AND SAFETY GRATE

For the

LITTLE RIVER BAND OF OTTAWA INDIANS

- I. This Addendum is issued to all registered plan holders pursuant to the Instructions to Bidders and Conditions of the Contract. This Addendum serves to clarify, revise and supersede information in the Project Manual, Drawings and previously issued Addenda. Portions of the Addendum affecting the Contract Documents will be incorporated into the Contract by Enumeration in the Owner/Contractor Agreement.
- II. The Bidder shall acknowledge receipt of this Addendum in the appropriate space on the Bid Form.
- III. The date for receipt of bids is unchanged and remains as follows: Bids will be received by 2:00 p.m. (Eastern Time) on **Thursday, May 1, 2025**, and then publicly opened and read aloud at 2:00 p.m. the same day.
- IV. The following changes/clarifications are made to the project manual.
 - a. Creation of Appendix A, which attaches the control schematic/wiring diagram for the lift station.
- V. The plan set is unchanged by this addendum.



Dated: April 21, 2025

Allison Dodd, E.I.T., Indian Health Service
for the Little River Band of Ottawa Indians

Hoosier Aki

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

FIELD WIRING CONNECTIONS

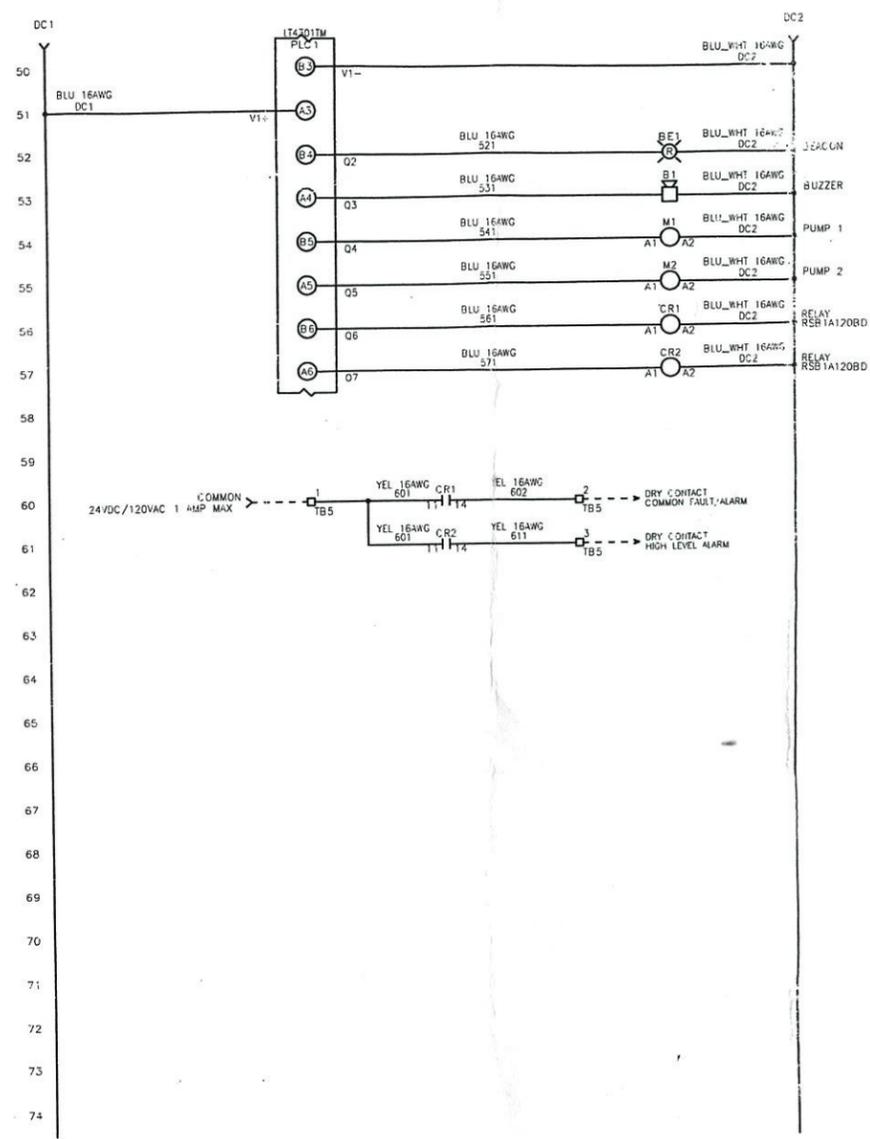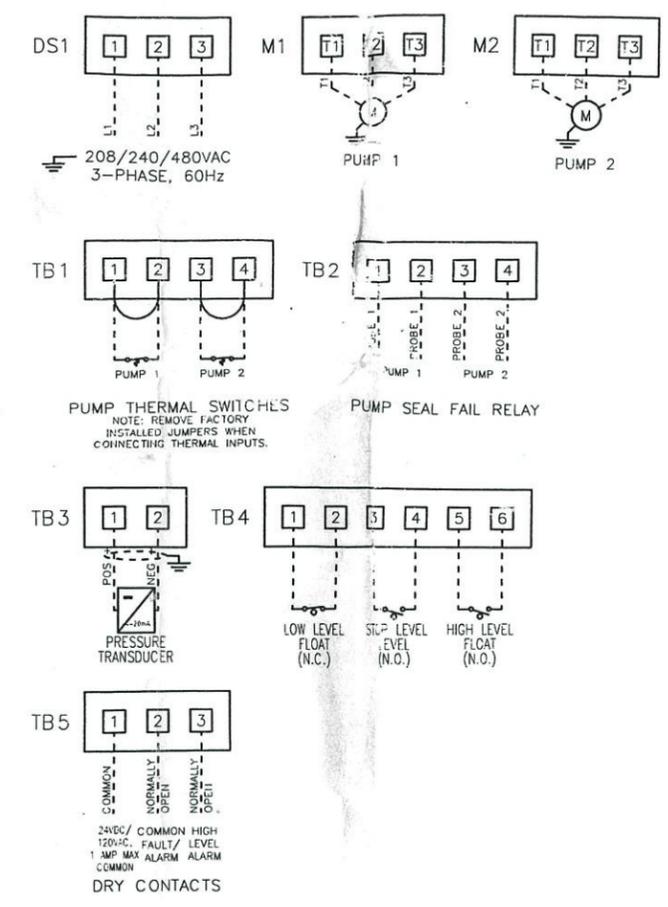

FNAME: HTRD-33-20-SFD-SS4
REVDATE: 1020

DASHED LINE INDICATES USE COPPER CONDUCTORS ONLY. FIELD WIRING.

TEMPERATURE RATING OF CONDUCTORS IS TO BE:
60°C (140°F) FOR UNDER 100A.
75°C (167°F) FOR OVER 100A.

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

FIELD WIRING TORQUE SPECS.		UL #:	DRAWN BY:	DATE:
TERMINAL BLOCK UT 2,5	5 IN-LB	E320866	JED	10/28/20
TERMINAL BLOCK UT 4	7 IN-LB	TOTAL FLA:	APPROVED BY:	DATE:
TERMINAL BLOCK UT 6	15 IN-LB	65.3 A	KM	10/28/20
TERMINAL BLOCK UT 10	15 IN-LB	LARGEST MOT. FLA		
TERMINAL BLOCK UT 16	25 IN-LB	32 A		
TERMINAL BLOCK UT 35	30 IN-LB	VOLTAGE:		
TS1, TS2, J2 & J3 PCB	5 IN-LB	208/240/480 VAC		
TRANSFORMER H1F, H2F & H3F	15 IN-LB	PHASE:		
TRANSFORMER H1, H2 & H3	10 IN-LB	3 PH		
DS1 VLS3P16-63 R1	16 IN-LB	FREQUENCY:		
DS1 VLS3P63-125 R2	45 IN-LB	60 Hz		
DS1 LK4JU3CN 130A	36 IN-LB	ENCLOSURE TYPE:		
DS1 LK4MU3N 200A	200 IN-LB	TYPE 4X		
		SHORT CURRENT CIRCUIT:		
		5KA RMS SYMMETRICAL		
		600V MAXIMUM		

THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.





TITLE: HTRD-33-20-SFD-SS4 CONTROL SCHEMATIC			
SIZE: B	DWG NO. 1981	PART NO. HTRD-33-20-SFD-SS4	REV
SCALE: NONE	SHEET 2 OF 2		

Mousing AKI

FRAME: HTRD-33-20-SFD-SS4

REVDATE: 1020

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

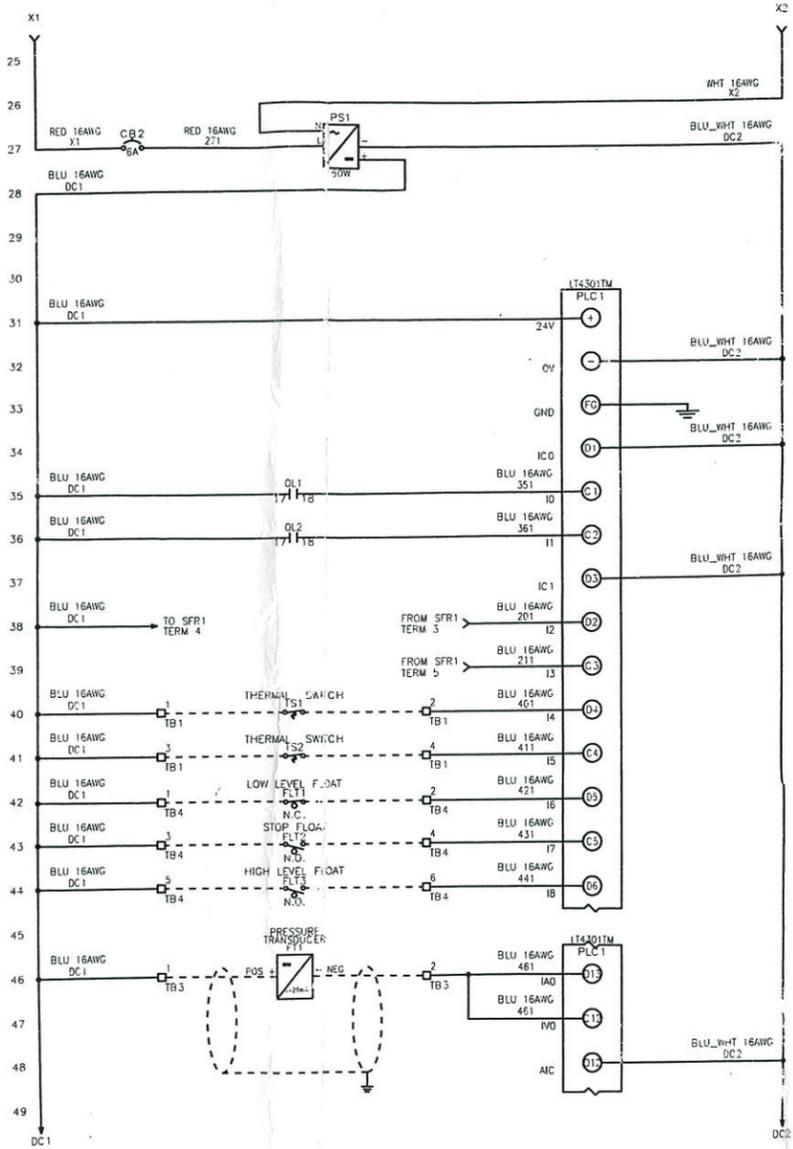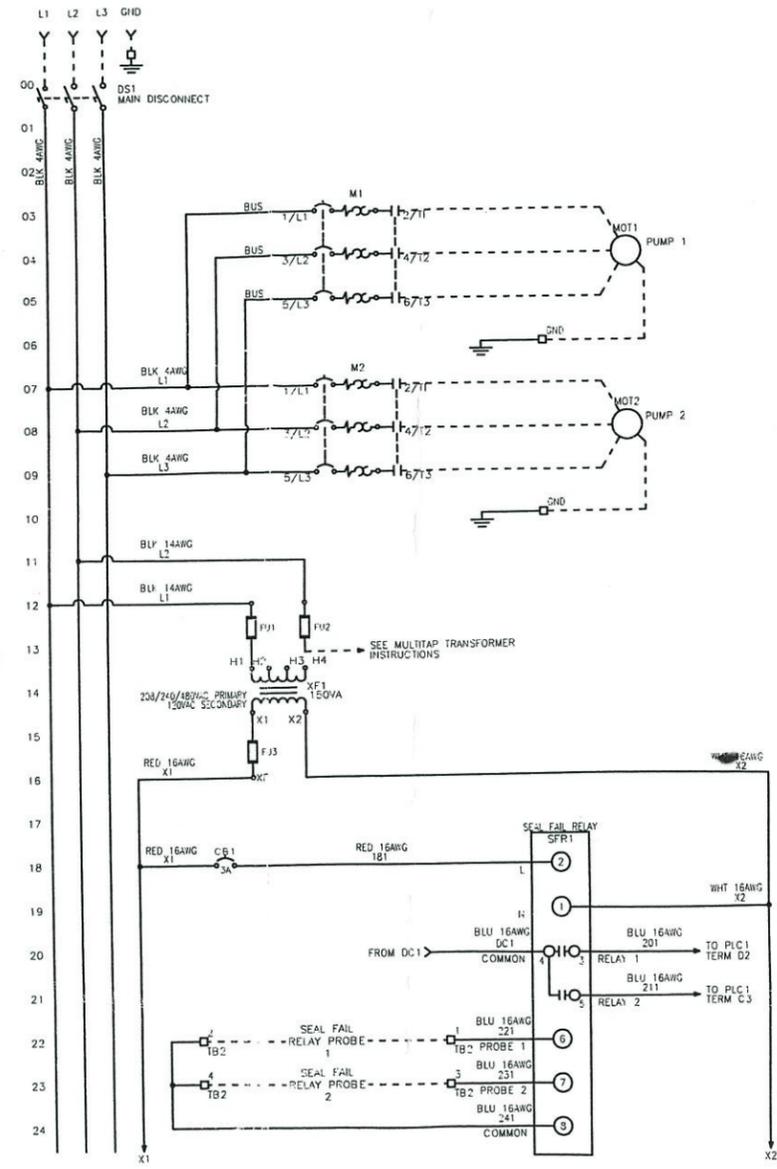

DASHED LINE INDICATES USE COPPER CONDUCTORS ONLY. FIELD WIRING.

TEMPERATURE RATING OF CONDUCTORS IS TO BE: 60°C (140°F) FOR UNDER 100A. 75°C (167°F) FOR OVER 100A.

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

FIELD WIRING TORQUE SPECS.		UL #:	UL #:
TERMINAL BLOCK UT 2,5	5 IN-LB	E320866	
TERMINAL BLOCK UT 4	7 IN-LB		
TERMINAL BLOCK UT 6	15 IN-LB	TOTAL FLA:	LARGEST MOT. FLA
TERMINAL BLOCK UT 10	15 IN-LB	65.3 A	32 A
TERMINAL BLOCK UT 16	25 IN-LB	VOLTAGE:	PHASE:
TERMINAL BLOCK UT 35	30 IN-LB	208/240/480 VAC	3 PH
TS1, TS2, J2 & J3 PCB	5 IN-LB	FREQUENCY:	ENCLOSURE TYPE:
TRANSFORMER H1F, H2F & H3F	15 IN-LB	60 Hz	TYPE 4X
TRANSFORMER H1, H2 & H3	10 IN-LB	SHORT CURRENT CIRCUIT:	
DS1 VLS3P16-63 R1	16 IN-LB	5KA RMS SYMMETRICAL	
DS1 VLS3P63-125 R2	45 IN-LB	600V MAXIMUM	
DS1 LK4JU3CN 100A	36 IN-LB		
DS1 LK4MU3N 200A	200 IN-LB		

DRAWN BY: JED DATE: 10/28/20

APPROVED BY: KM DATE: 10/28/20

THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.

ph: 951-487-8073 Tech/Brandon



TITLE: HTRD-33-20-SFD-SS4 CONTROL SCHEMATIC			
SIZE: B	DWG NO.: 1981	PART NO.: HTRD-33-20-SFD-SS4	REV:
SCALE: NONE	SHEET: 1 OF 2		